

Temperature Log

The Jikei University Hospital

Location : Pharmaceutical department

Refrigerator Name: ER-49C


Acceptable Temperature Range : 2°C to 8°C

Temperature Logger/ID : RTR501BL/ 52802EFD (Calibration date ; 29 Sep 2025)

※The certification period is one year from the date of calibration.

Month/Year (年月) (MMM/YYYY) : <u>NOV /2025</u>	Confirmation Time 確認時間	Alarm: No or Yes アラームの有無	Initials (確認者)
Date(日)			
1	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
2	:	No · Yes	
3	:	No · Yes	
4	8 : 30	<input checked="" type="radio"/> No · Yes	S.H
5	11 : 00	<input checked="" type="radio"/> No · Yes	S.H
6	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
7	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
8	9 : 00	<input checked="" type="radio"/> No · Yes	Y.N
9	:	No · Yes	
10	10 : 20	<input checked="" type="radio"/> No · Yes	S.H
11	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
12	8 : 30	<input checked="" type="radio"/> No · Yes	S.H
13	9 : 30	<input checked="" type="radio"/> No · Yes	S.H
14	8 : 30	<input checked="" type="radio"/> No · Yes	R.Y
15	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
16	:	No · Yes	
17	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
18	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
19	9 : 30	<input checked="" type="radio"/> No · Yes	S.H
20	11 : 10	<input checked="" type="radio"/> No · Yes	Y.N
21	11 : 00	<input checked="" type="radio"/> No · Yes	S.H
22	9 : 30	<input checked="" type="radio"/> No · Yes	S.H
23	:	No · Yes	
24	:	No · Yes	
25	9 : 30	<input checked="" type="radio"/> No · Yes	S.H
26	9 : 20	<input checked="" type="radio"/> No · Yes	Y.N
27	9 : 30	<input checked="" type="radio"/> No · Yes	S.H
28	10 : 30	<input checked="" type="radio"/> No · Yes	S.H
29	9 : 00	<input checked="" type="radio"/> No · Yes	S.H
30	:	No · Yes	
31	:	No · Yes	

Investigational Product Manager's Signature: Shunsuke Hitosugi Date: 02/Dec/2025

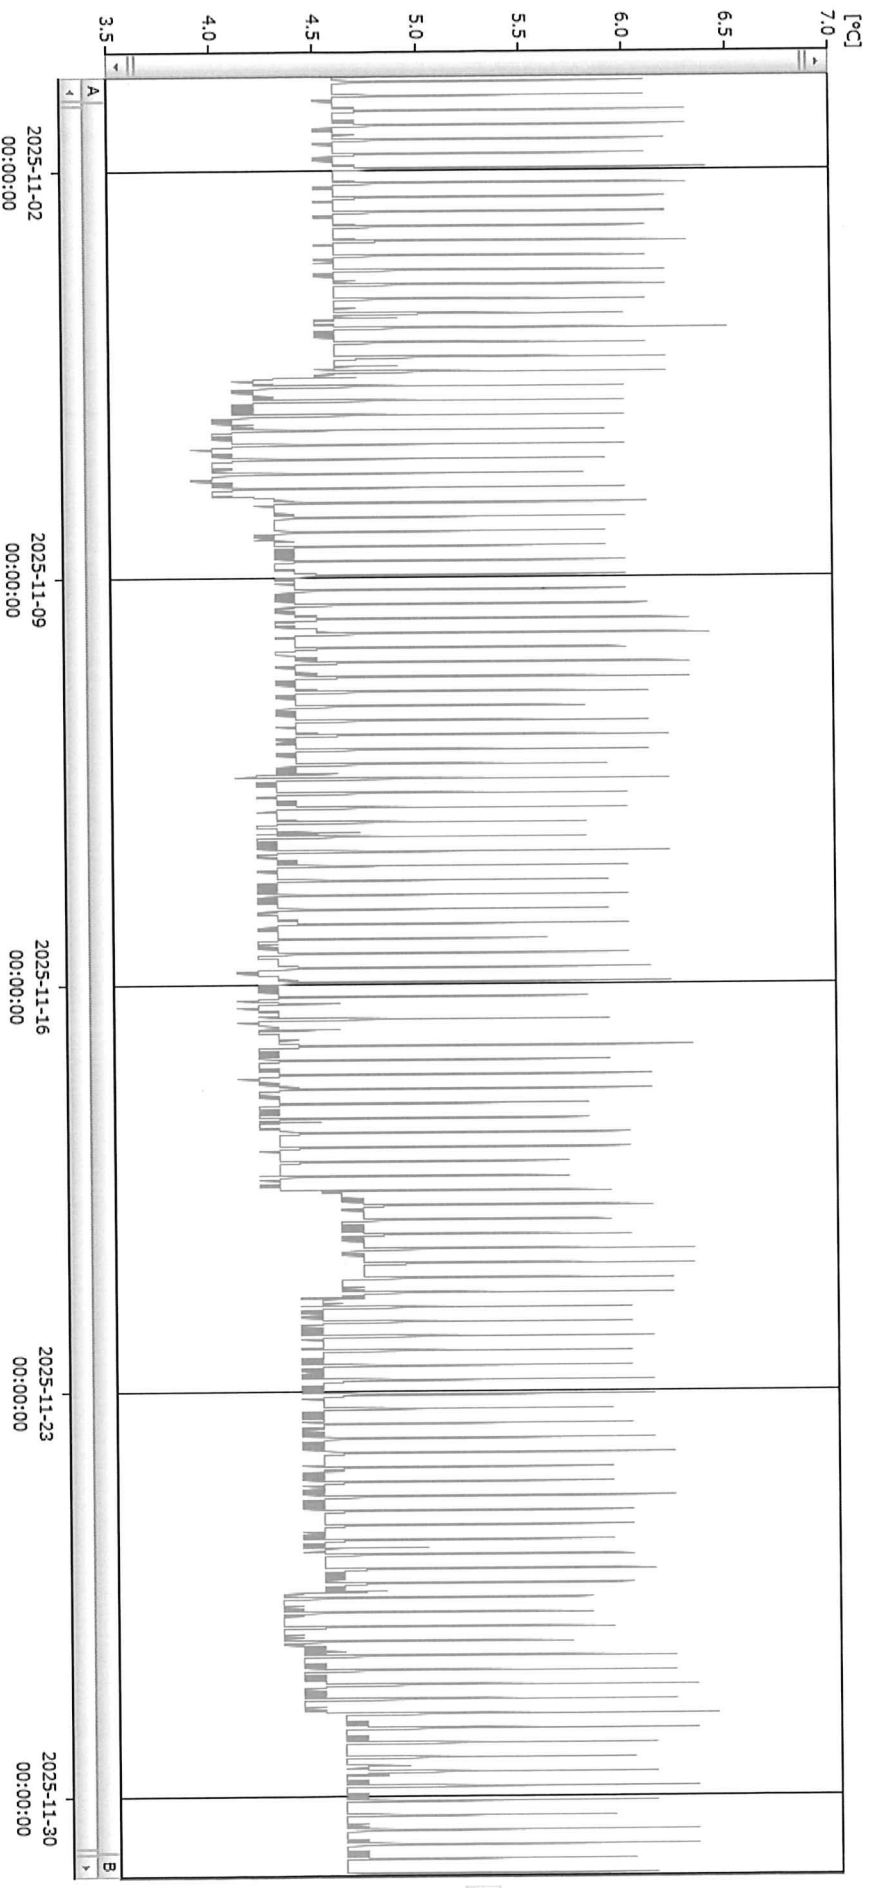

表示範囲 2025-10-31 08:59:00 - 2025-12-01 08:56:00
 計算範囲 2025-10-31 08:59:00 - 2025-12-01 08:56:00

Sunsuke Hifusy: 02-Dec-2025

No.	チャンネル名	記録間隔	データ数	単位	最大値	最小値	平均値
No.1	冷所A	5 min.	8928	°C	6.5	3.9	4.5