

Temperature Log

The Jikei University Hospital

Location : Pharmaceutical department

Acceptable Temperature Range : Room temperature

Temperature Logger/ID : RTR501BL/ 52802EFC (Calibration date ; 29 Sep 2025)


※The certification period is one year from the date of calibration.

Month/Year (年月) (MMM/YYYY) : <u>Apr/2026</u>	Confirmation Time 確認時間	Alarm: No or Yes アラームの有無	Initials (確認者)
Date(日)			
1	11 : 00	<input checked="" type="radio"/> No · Yes	R-Y
2	8 : 30	<input checked="" type="radio"/> No · Yes	S-H
3	8 : 30	<input checked="" type="radio"/> No · Yes	S-H
4	16 : 30	<input checked="" type="radio"/> No · Yes	S-H
5	:	No · Yes	
6	10 : 00	<input checked="" type="radio"/> No · Yes	S-H
7	8 : 30	<input checked="" type="radio"/> No · Yes	R-Y
8	9 : 30	<input checked="" type="radio"/> No · Yes	S-H
9	9 : 30	<input checked="" type="radio"/> No · Yes	S-H
10	10 : 30	<input checked="" type="radio"/> No · Yes	S-H
11	8 : 30	<input checked="" type="radio"/> No · Yes	S-H
12	:	No · Yes	
13	8 : 30	<input checked="" type="radio"/> No · Yes	S-H
14	10 : 30	<input checked="" type="radio"/> No · Yes	S-H
15	9 : 30	<input checked="" type="radio"/> No · Yes	S-H
16	8 : 30	<input checked="" type="radio"/> No · Yes	S-H
17	9 : 00	<input checked="" type="radio"/> No · Yes	S-H
18	9 : 10	<input checked="" type="radio"/> No · Yes	R-Y
19	:	No · Yes	
20	8 : 45	<input checked="" type="radio"/> No · Yes	R-Y
21	10 : 45	<input checked="" type="radio"/> No · Yes	S-H
22	8 : 30	<input checked="" type="radio"/> No · Yes	S-H
23	9 : 50	<input checked="" type="radio"/> No · Yes	S-H
24	9 : 50	<input checked="" type="radio"/> No · Yes	S-H
25	9 : 15	<input checked="" type="radio"/> No · Yes	S-H
26	:	No · Yes	
27	9 : 00	<input checked="" type="radio"/> No · Yes	S-H
28	15 : 00	<input checked="" type="radio"/> No · Yes	S-H
29	:	No · Yes	
30	9 : 00	<input checked="" type="radio"/> No · Yes	S-H
31	:	No · Yes	

Investigational Product Manager's Signature: Shunsuke Hitosygi

Date: 07 May 2026

shunsuke Hitosugi 07 May 2026

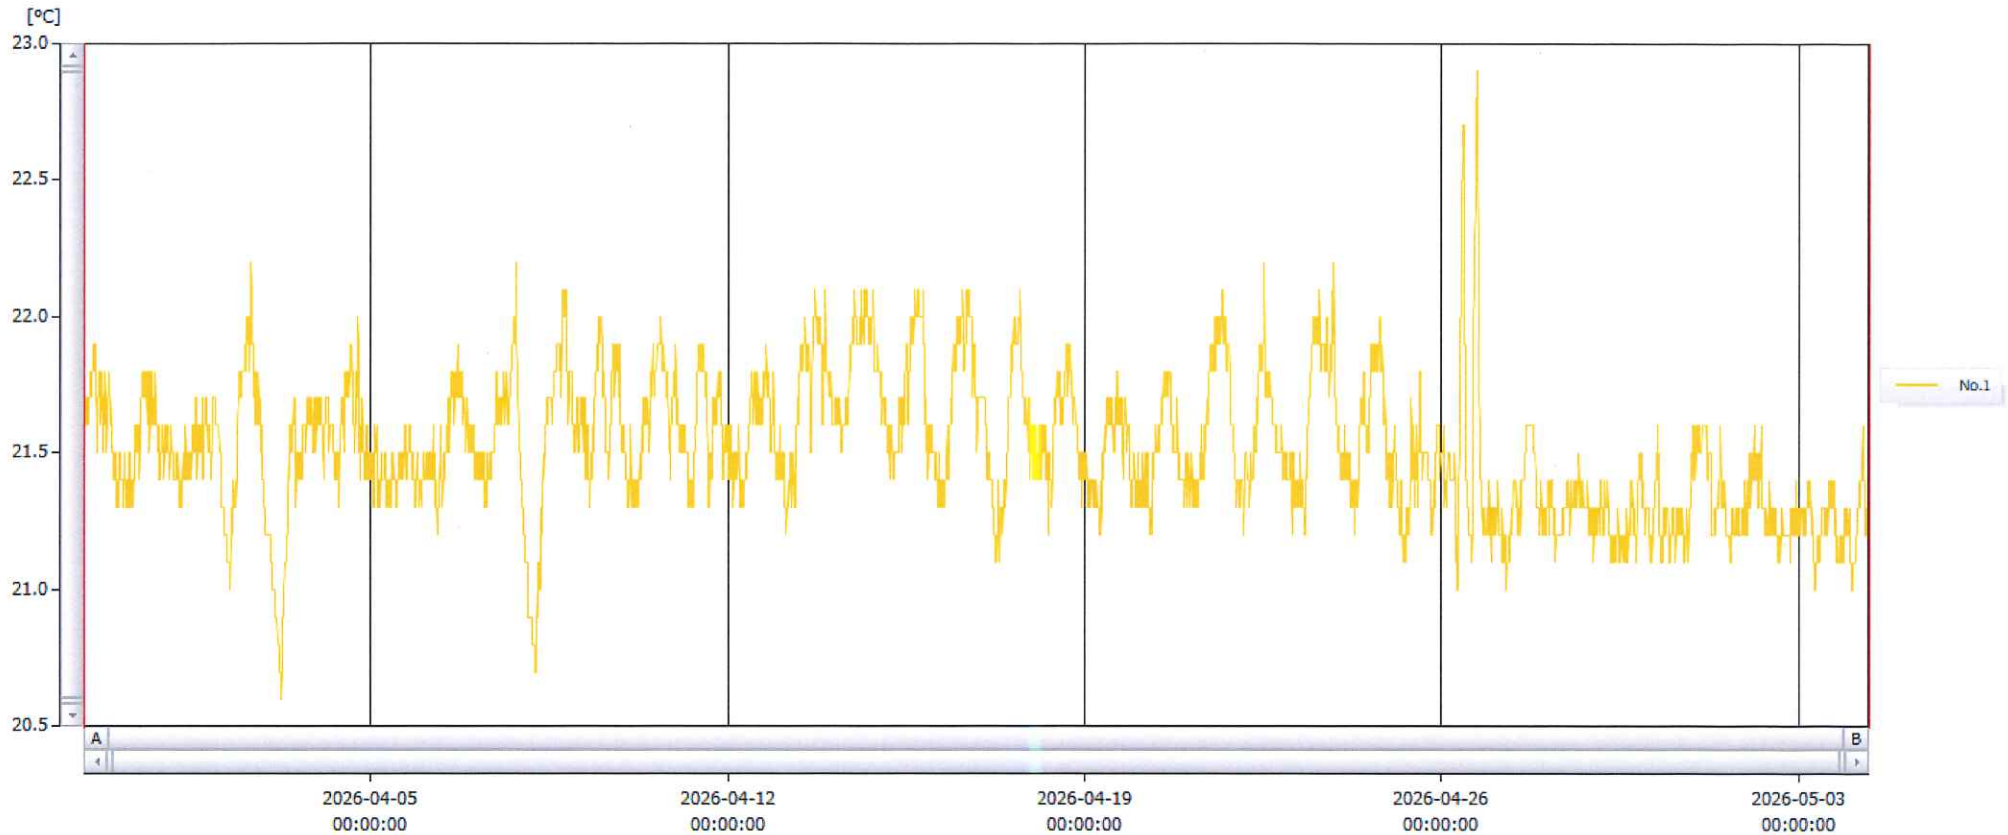

表示範囲 2026-03-30 09:04:00 - 2026-05-04 09:00:00

計算範囲 2026-03-30 09:04:00 - 2026-05-04 09:00:00

No.	チャンネル名	記録間隔	データ数	単位	最大値	最小値	平均値
No.1	室温	5 min.	10080	°C	22.9	20.6	21.5