

Temperature Log

The Jikei University Hospital

Location : Pharmaceutical department

Refrigerator Name: ER-49C

Acceptable Temperature Range : 2°C to 8°C


Temperature Logger/ID : RTR501BL/ 52802EFD (Calibration date ; 29 Sep 2025)

※The certification period is one year from the date of calibration.

Month/Year (年月) (MMM/YYYY) : JUL/2026	Confirmation Time 確認時間	Alarm: No or Yes アラームの有無	Initials (確認者)
Date(日)			
1	14 : 30	☒ No • Yes	S-H
2	9 : 00	☒ No • Yes	S-H
3	10 : 10	☒ No • Yes	R.Y
4	9 : 45	☒ No • Yes	S-H
5	:	☒ No • Yes	
6	9 : 00	☒ No • Yes	S-H
7	15 : 00	☒ No • Yes	S-H
8	8 : 40	☒ No • Yes	R.Y
9	9 : 50	☒ No • Yes	S-H
10	9 : 25	☒ No • Yes	R.Y
11	8 : 30	☒ No • Yes	Y.N
12	:	☒ No • Yes	
13	8 : 30	☒ No • Yes	Y.N
14	8 : 40	☒ No • Yes	Y.N
15	9 : 40	☒ No • Yes	R.Y
16	16 : 50	☒ No • Yes	S-H
17	9 : 00	☒ No • Yes	S-H
18	9 : 00	☒ No • Yes	S-H
19	:	☒ No • Yes	
20	:	☒ No • Yes	
21	15 : 00	☒ No • Yes	S-H
22	14 : 00	☒ No • Yes	S-H
23	11 : 30	☒ No • Yes	S-H
24	9 : 00	☒ No • Yes	Y.N
25	14 : 00	☒ No • Yes	S-H
26	:	☒ No • Yes	
27	9 : 30	☒ No • Yes	S-H
28	9 : 00	☒ No • Yes	S-H
29	17 : 00	☒ No • Yes	S-H
30	14 : 00	☒ No • Yes	S-H
31	11 : 00	☒ No • Yes	Y.N

Investigational Product Manager's Signature: Shinsuke Hitosugi

Date: 04 Aug 2026

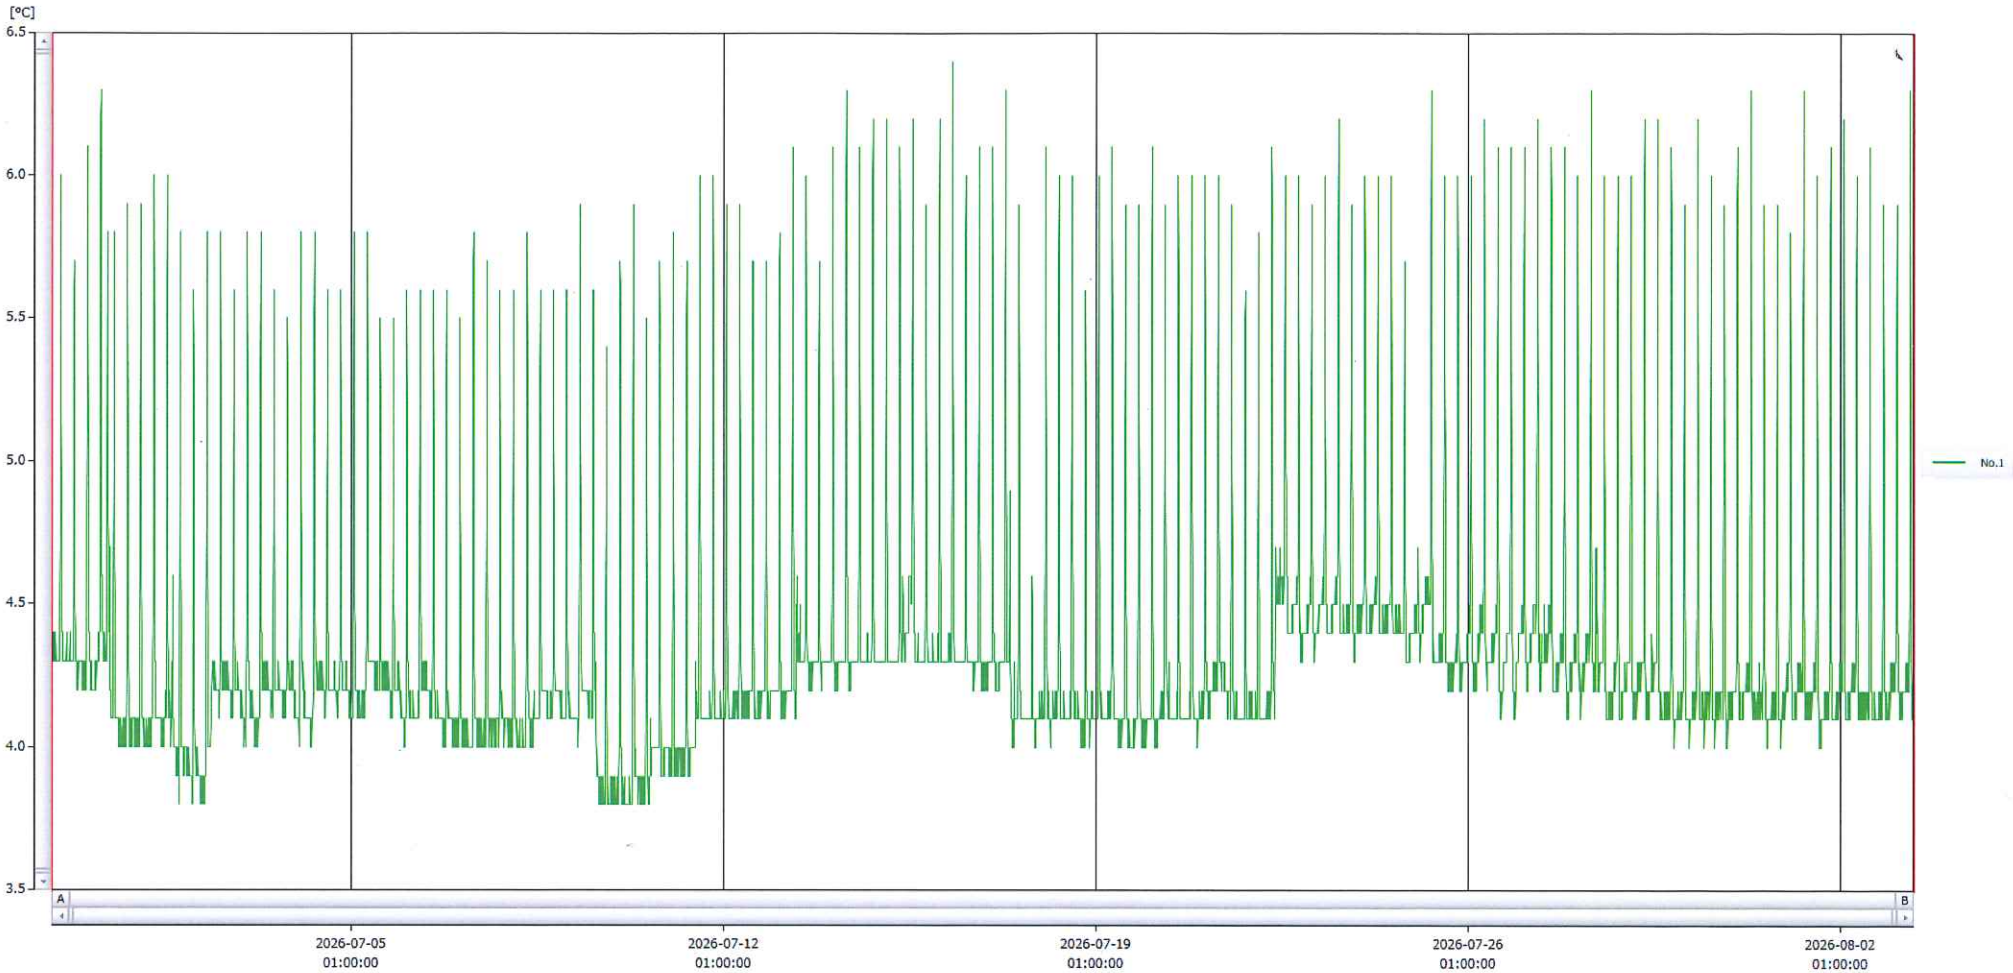

表示範囲 2026-06-29 10:00:00 - 2026-08-03 09:56:00
計算範囲 2026-06-29 10:00:00 - 2026-08-03 09:56:00

No.	チャンネル名	記録間隔	データ数	単位	最大値	最小値	平均値
No.1	冷所A	5 min.	10080	°C	6.4	3.8	4.3